

Current status of ground source heat pumps in Europe

Burkhard Sanner

Inst. of Applied Geosciences, Justus-Liebig-University, Diezstrasse 15, D-35633 Giessen,
burkhard.sanner@geolo.uni-giessen.de

Abstract

Geothermal Heat Pumps, or Ground Source Heat Pumps (GSHP), are systems combining a heat pump with a ground heat exchanger (closed loop systems), or fed by ground water from a well (open loop systems). They use the earth as a heat source when operating in heating mode, with a fluid (usually water or a water-antifreeze-mixture) as the media transferring the heat from the earth to the evaporator of the heat pump, utilising that way geothermal energy. In cooling mode, they use the earth as a heat sink. With borehole heat exchangers (BHE) geothermal heat pumps can offer both heating and cooling at virtually any location, with great flexibility to meet any demands. More than 20 years of R&D focusing on BHE in Europe resulted in a well-established concept of sustainability for this technology, as well as sound design and installation criteria. Recent developments are the Thermal Response Test, which allows in-situ-determination of ground thermal properties for design purposes, and thermally enhanced grouting materials to reduce borehole thermal resistance.

Despite the use of geothermal heat pumps for over 50 years now (first in USA), market penetration of this technology, is still at its infancy, with fossil fuels dominating the market of heating of buildings and air-to-air heat pumps dominating the market of cooling of buildings. In some countries, namely Germany, Switzerland, Austria, Sweden, Denmark, Norway, France and USA, already larger numbers of geothermal heat pumps are operational. In these countries meanwhile installation guidelines, quality control and contractor certification becomes a major issue.

Keywords

Ground Source Heat Pumps, Market, Design

Introduction

Most European countries do not boast abundant hydro-geothermal resources that could be tapped for direct heat use (some exceptions are e.g. Iceland, Hungary, France). The utilization of low-enthalpy aquifers which enable the supply of a larger number of customers by district heating is limited so far to regions with specific geological settings.

In this situation the utilization of the ubiquitous shallow geothermal resources by de-central GSHP systems is an obvious option. Correspondingly, a rapidly growing field of applications is emerging and developing in various European countries. A rapid market penetration of such

systems is resulting; the number of commercial companies actively working in this field is ever increasing and their products have reached the “yellow pages” stage.

The climatic conditions in Central and Northern Europe, where most of the market development took place, are such that by far the most demand is for space heating; air conditioning is rarely required. Therefore, unlike the “geothermal heat pumps” in the USA, the heat pumps usually operate mainly in the heating mode. Only in very recent years the installation of GSHP in Southern Europe, in particular in Greece and Western Turkey, is on the way to exceed demonstration status. With the inclusion of larger commercial applications, requiring cooling, and the ongoing proliferation of the technology into Southern Europe, the double use for heating and cooling will become of more importance in the future.

GSHP technology status

Ground Source Heat Pumps (GSHP), or Geothermal Heat Pumps, are systems combining a heat pump with a system to exchange heat with the ground (fig. 1). The systems can be divided basically into those with a ground heat exchanger (closed loop systems), or those fed by ground water from a well (open loop systems). The means to tap the ground as a shallow heat source comprise:

- groundwater wells ("open" systems)
- borehole heat exchangers (BHE)
- horizontal heat exchanger pipes (incl. compact systems with trenches, spirals etc.)
- “geostructures” (foundation piles equipped with heat exchangers)

Experimental and theoretical investigations (field measurement campaigns and numerical model simulations) have been conducted over several years to elaborate a solid base for the design and for performance evaluation of BHE systems (see KNOBLICH et al., 1993; RYBACH & EUGSTER, 1997). While in the 80's theoretical thermal analysis of BHE-systems prevailed in Sweden (CLAESSON & ESKILSON, 1988; ESKILSON & CLAESSON, 1988), monitoring and simulation was done in Switzerland (GILBY & HOPKIRK, 1985; HOPKIRK ET AL., 1988), and measurements of ground heat transport were made on a test site in Germany (SANNER, 1986).

GSHP performance and efficiency

A typical BHE-installation, as built from the 1980's until now, is shown in fig. 1. These systems use the earth as a heat source when operating in heating mode, with a fluid (usually water or a water-antifreeze-mixture) as the media transferring the heat from the earth to the evaporator of the heat pump, utilising in that way geothermal energy. In the cooling mode, they use the earth as a heat sink. For each kWh of heating or cooling output, they currently require 0,22 - 0,35 kWh electricity, which is 30%-50% less than the seasonal power consumption of air-to-air heat pumps, which use the atmosphere as a heat source/sink.

The ratio of useful energy over electricity consumption of a heat pump at given operating conditions is defined as the “Coefficient of Performance” or the COP. The COP depends on the temperature of the input water from the ground circuit, which depends on geological conditions (thermal and hydraulic parameters of the underground, climatic setting) and technical parameters (length and type of ground heat exchanger, material, type and quality of grouting, etc.). Other factors that affect the COP of a heat pump are the heating/cooling load, the type of the building heating/cooling system and the relevant supply temperatures. Since at depths

below ca. 10 meters the ground temperature is constant throughout the year (depending upon prevailing weather conditions or ambient temperature) and increases slightly with depth beneath the ground surface, BHE show better performance and energy efficiency than horizontal ground heat exchangers.

In the USA, the Water-Source Heat Pump Engineering Committee recommends a COP of 3,1 for heating and 3,9 for cooling for ground loop systems. Values from measurements in Europe, mainly in the Swiss heat pump test centre in Töss, already show substantial higher ratings. For a source temperature of 0 °C, values close to COP = 5 can be achieved for 35 °C heating supply temperature, and still values around COP = 3.5 for 50 °C supply temperature (see Fig. 2).

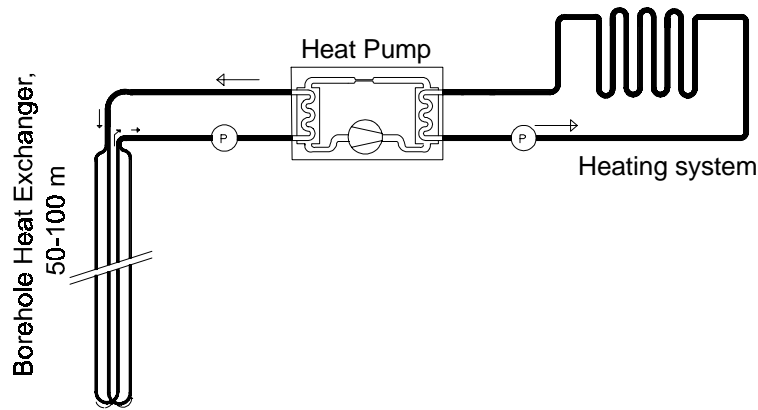


Fig. 1: Typical application of a BHE / heat pump system in a Central European home, typical BHE length ≥ 100 m

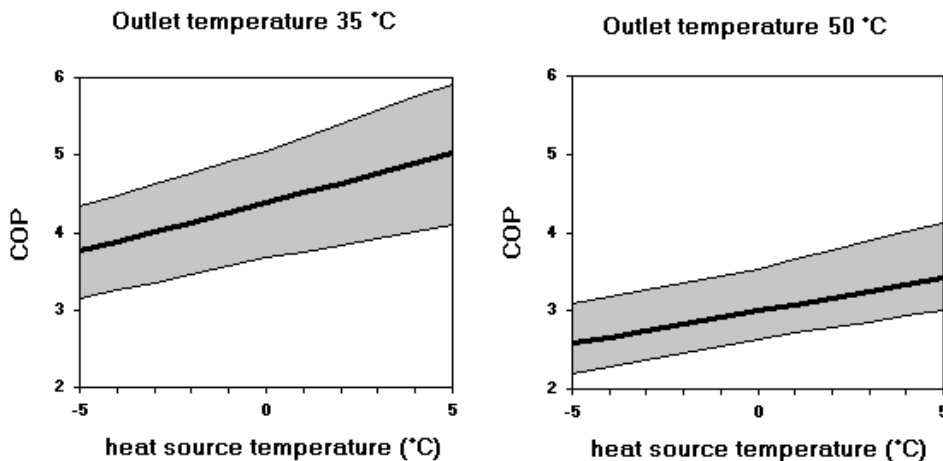


Fig. 2: Values of COP for brine/water heat pumps (as used typically in geothermal heat pump systems), measured in the Heat Pump Test Centre Toess (extract from <http://www.wpz.ch/>)

Although the maximum COP of existing ground source heat pumps is around 4,5 their mean COP during operation is lower. This mean COP, usually called “Seasonal Performance Factor” (SPF), is defined as the mean COP during operation and varies at around SPF=3,0-3,8. In cases where high quality standards for all components of a geothermal heat pump system are applied and also an optimum building heating system exists, values of SPF=4,0 can be achieved; in these cases usually no domestic hot water can be provided by the heat pump.

GSHP ground loop design

When using (BHE), the required length for a given power output is highly dependent upon soil characteristics including temperature, moisture content, particle size and shape, and heat transfer coefficients. Correct sizing of the BHE continues to be a cause for continued design concern, and special attention should be placed on minimising interference between neighbouring BHE. Key points are building load, borehole spacing, borehole fill material and site characterisation. Due to the high capital costs involved, over-sizing carries a much higher penalty than in conventional applications.

Two important developments of recent years should be mentioned in this respect:

- Thermal Response Test to determine the thermal parameters of the underground in situ
- Easy-to-use PC programs for BHE sizing

For a thermal response test (SANNER et al., 2000), basically a defined heat load is put into the BHE and the resulting temperature changes of the circulating fluid are measured (fig. 3). Since mid 1999, this technology now also is in use in Central Europe for the design of larger plants with BHE, allowing sizing of the boreholes based upon reliable underground data. Thermal response test first was developed in Sweden and USA in 1995 (EKLÖF & GEHLIN, 1996; AUSTIN, 1998) and now is used in many countries world-wide, including Turkey. Several papers in this volume deal with theory of thermal response test and experiences gained. In combination of thermal response test and reliable design software, BHE can be made a sound and safe technology even for larger applications.

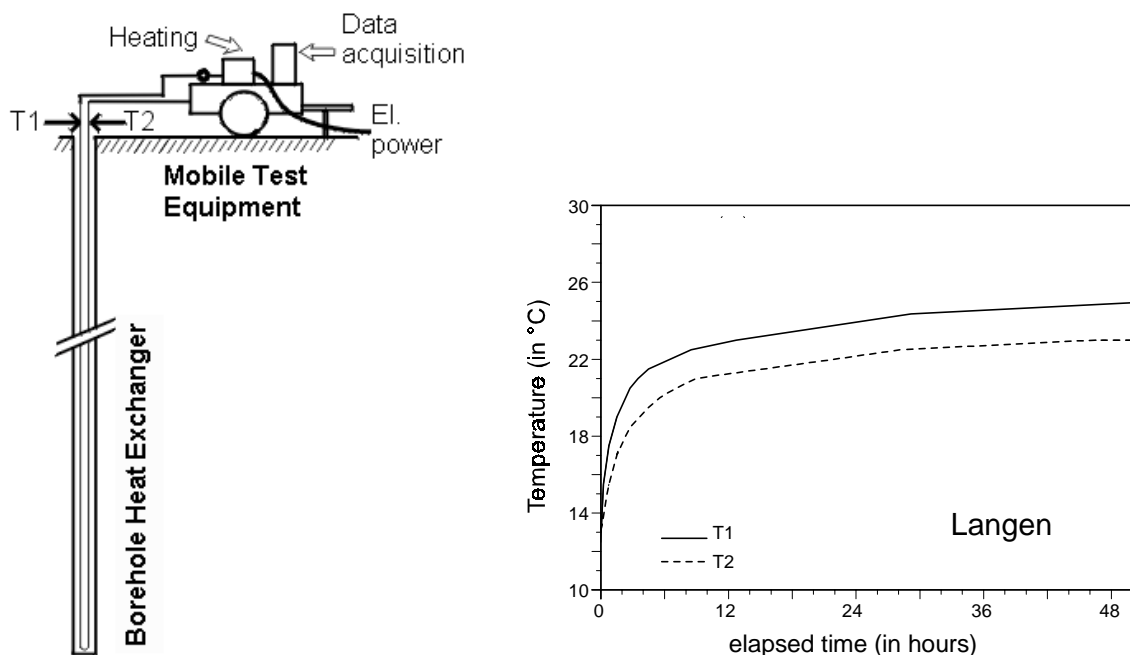


Fig. 3: left: Schematic of a Thermal Response Test
right: Example of measured data from a Thermal Response Test, from SANNER et al. (2000)

Design of ground heat exchangers for heat pumps is increasingly done with the support of easy-to-use, fast computer programs. These programs vary widely in calculation approach and accuracy. Three groups are shortly reviewed here:

- Programs based on the concept of *g*-functions EED, GLHEPRO
- A program using a cylinder source approach GchpCalc
- other programs GS2000, EWS

A more detailed discussion can be found in HELLSTRÖM & SANNER (2001).

PC-programs for quick and reasonably sound dimensioning of ground heat systems with BHE have been presented by CLAEISSON et al. (1988). The algorithms have been derived from modeling and parameter studies with the numerical simulation model SBM, evolving to an analytical solution of the heat flow with several functions for the borehole pattern and geometry (*g*-functions, see ESKILSON, 1987). Those *g*-functions depend on the spacing between the boreholes at the ground surface and the borehole depth. The *g*-function values obtained from the numerical simulations have been stored in a data file, which is accessed for rapid retrieval of data by the PC-programs. To make working with this concept easier, and to add other features, some more user-friendly programs have been developed on the same basis, e.g. the program EED, which is described below, and GLHEPRO (SPITLER, 2000; see also <http://www.mae.okstate.edu/Faculty/spitler/glhewin/glhepro.html>)

In the program EED (HELLSTRÖM & SANNER, 1994; HELLSTRÖM et al., 1997) the calculation of brine temperatures is done for monthly heat/cool loads. Databases provide the key ground parameters (thermal conductivity, specific heat) as well as properties of pipe materials and heat carrier fluids. The user can choose between different methods of establishing a monthly load profile. A printed output report and output files containing data for graphical processing were provided in version 1.0 under MS-DOS; version 2.0, running under MS-Windows 95 and higher, offers direct graphical output.

KAVANAUGH (1984) developed a method that uses the cylindrical source solution and approximates the time varying nature of the heat extraction/addition to the ground using a steady state solution and effective thermal resistance. The basic method follows the approach of INGERSOLL et al. (1948) where cyclic pulses of heat from a line source are approximated. This method has been implemented in the software program GchpCalc and has been used widely within the United States for design of vertical ground-coupled systems (KAVANAUGH & RAFFERTY, 1997). Like the *g*-function method, Kavanaugh's method allows for the thermal interaction of adjacent boreholes and the possibility for long term heat buildup/depletion within the ground.

Some other attempts have been made to develop easy-to-use design programs. For saving computing time, analytical solutions have been tried (e.g. SMOLEN & SZAFLIK, 1997). The line source or the cylinder source concept is the basis for some computer codes, as GS2000 (Caneta Research, see MORRISON, 2000). An approach of combining numerical simulation of the direct surroundings of the BHE with other methods to determine the farfield is used by HUBER & SCHULER (1997). Many other programs have a focus on the heat pump design for residential houses, and treat the ground using empirical values only; these programmes do not qualify for design of larger BHE fields.

The reliability of ground loop design programs is limited due to the simplifying assumptions necessary for fast calculation. In a study performed at Oak Ridge National Laboratory (SHONDER & HUGHES, 1998) several programs used in North America were tested against each other and against a simulation using TRNSYS with the BHE-module called DST. In the latest benchmark test (fig. 4), SHONDER (2000) writes: “A 1996 comparison for a cooling-dominated residential application using early versions of the software showed wide disagree-

ment: the variation among the five programs tested was about 30% of the mean value of the five. By 1999, however, new versions of the programs had been produced, and this variation had been reduced to about 11% of the mean.“

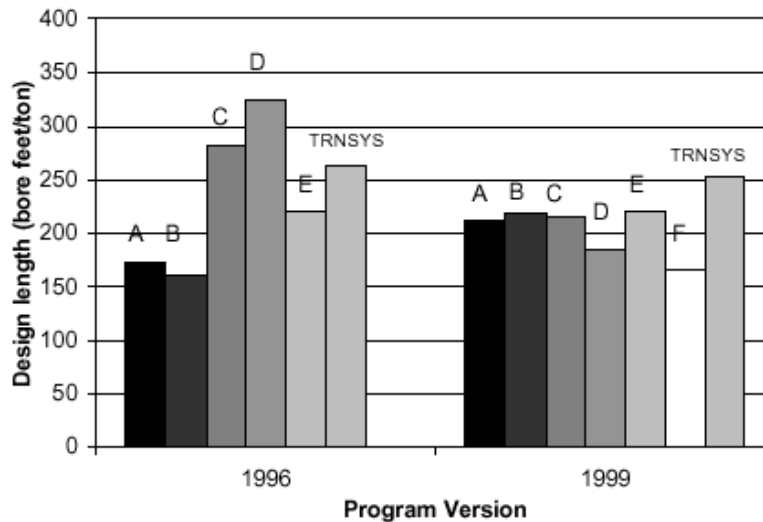


Fig. 4: One-year design lengths for maximum entering fluid temperature of 35 °C for the cooling-dominated residential benchmark, 1996 and 1999 versions of design programs (from SHONDER, 2000)

Grouting material with enhanced thermal conductivity

Thermally enhanced grouting material is available in USA since ca. 10 years. Meanwhile, also in Europe such material can be purchased. The advantage of its use is a significant reduction in the borehole thermal resistance, which governs the temperature losses between the undisturbed ground and the fluid inside the BHE pipes. A paper by SANNER in this volume gives more detail.

Another option to reduce the borehole thermal resistance is the use of spacers in order to keep the individual pipes apart and bring them closer to the borehole wall.

GSHP market opportunities and barriers

Problems often encountered with BHE design include inadequate address of flow, pressure drop and control parameters, leaks associated with corrosion of fittings, poor workmanship, as well as with the selection of pipe material and of the circulated heat transfer fluid. All of the above require the need for both a specialised engineer and a specialised contractor for the installation of ground source heat pumps, which is a significant barrier to their market penetration. In countries with higher sales numbers of geothermal heat pumps (e.g. Sweden, Switzerland or Germany), measures like technical guidelines, certification of contractors, quality awards etc. are beginning to be set into force to protect the industry and the consumers against poor quality and insufficient longevity of geothermal heat pump systems.

Existing geothermal heat pump features make them only suitable for their operation with low temperature heating systems, which limits their application mainly to new buildings, and they are not designed to meet the high supply temperature demands of older heating systems already installed in many existing buildings all over Europe. The heat pumps which provide

hot water feeding fan-coils, floor heating or low-temperature radiators, usually heat a water flow from 40°C to 45°C which circulates within the heating system of the buildings, with max temperature of 50°C. The higher the temperature of the supply water, the lower the COP of the heat pumps. Standard and maximum testing temperature values for liquid entering the indoor side in water-to-water systems are 40°C and 50°C respectively as per ISO 13256-2, and a maximum of 55 °C in some European guidelines.

The upper temperature limits encountered in commercially available heat pumps limit their application to low temperature heating systems, such as fan-coils, low temperature radiators or floor heating. However, traditional heating systems already installed in many buildings all over Europe, comprise a fossil fuel boiler and standard radiators, a high temperature heating system. These systems with radiators have been designed in order to use hot water of 80-90°C with a temperature drop of 10-20°C. As commercially available heat pumps are designed to provide water up to 50°C or 60°C with a temperature drop of 5-6°C, their installation in existing buildings implies the complete replacement of the high temperature heating system, namely the replacement of both radiators by fan coils or other advanced systems and piping of the buildings by pipes of larger diameter. In recent times, the development of a heat pump capable of delivering 65 °C water has been announced in Switzerland (SATAG/Viessmann; see <http://www.satagthermotechnik.ch/english/aktuell.htm>); this can be regarded as an initial step towards addressing the retrofit market for older buildings.

It is rather difficult to find reliable numbers of installed heat pumps in Europe, and in particular for the individual heat sources. Fig. 5 gives some recent data for the number of installed units in the main European heat pump countries. The extremely high number for Sweden in 2001 is the result of a large number of exhaust-air and other air-to-air heat pumps; however, Sweden also has the highest number of GSHP in Europe (see 1998 values in fig. 5).

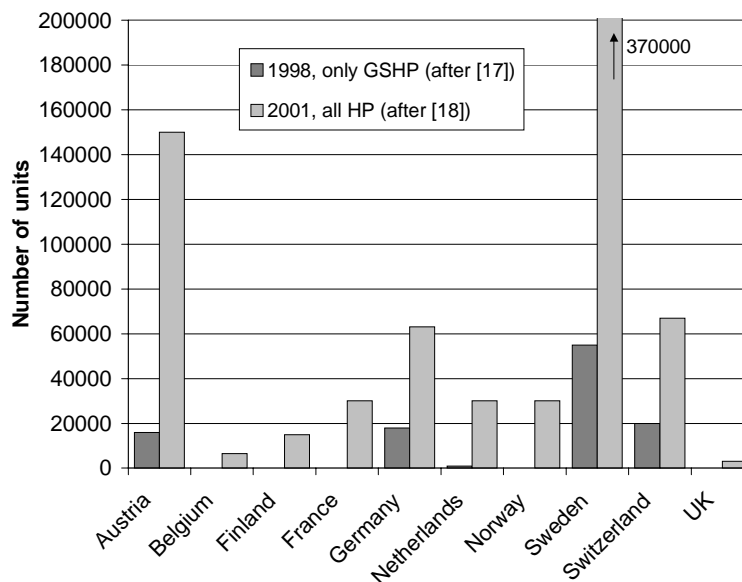


Fig. 5: Number of installed heat pump units in some European countries (after data from SANNER, 1999 and DONNERBAUER, 2003)

In general it can be concluded, that market penetration of GSHP still is modest throughout Europe, with the exception of Sweden and Switzerland (table 1). There is still ample opportunity for further market growth, and the technological prospects endorse this expectation. The Swiss example with a real boom of installed capacity (fig. 6) may encourage others. Also in

Germany the trend is positive (fig. 7), with a share of GSHP (ground and water) of about 82 % in 2002.

Table 1: Share of ground coupled heat pumps in total residential heating market (after data from VAN DE VEN, 1999)

Country	%
Austria	0.38
Denmark	0.27
Germany	0.01
Norway	0.25
Sweden	1.09
Switzerland	0.96

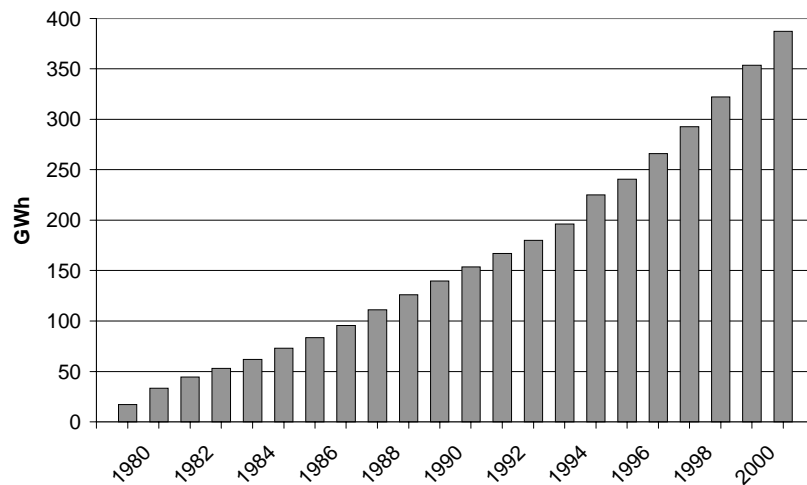


Fig. 6: Compilation of geothermal heat production (before the heat pump) by BHE systems in Switzerland (see WILHELM & RYBACH, 1999)

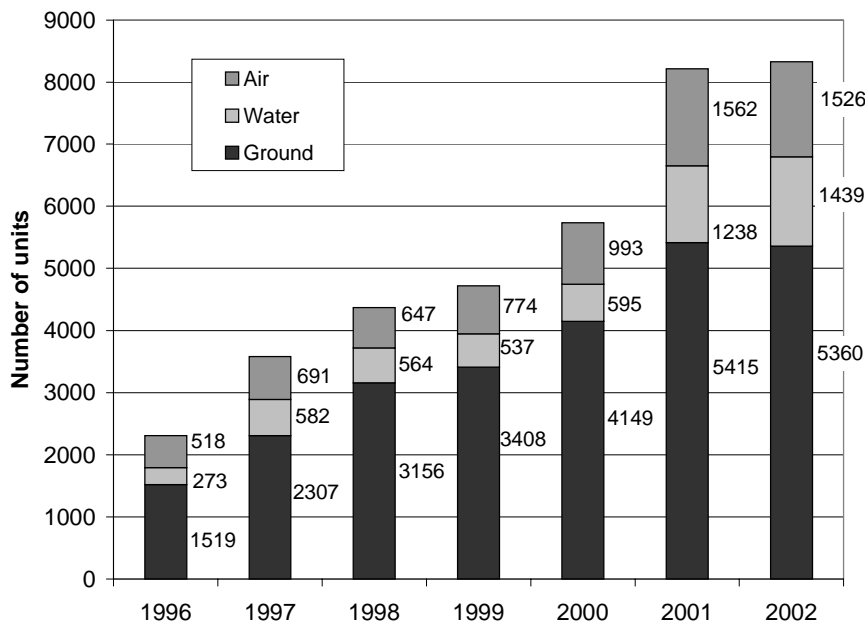


Fig. 7: Number of annual heat pump sales in Germany, according to heat sources (after data from IWZ e.V., Hannover and BWP e.V., Munich; heat pumps used for hot tap water production only are not included)

References

- AUSTIN, W. (1998): Development of an in-situ system for measuring ground thermal properties. - 164 p., MSc-thesis, OSU, Stillwater OK
- CLAESSON, J., ESKILSON, P. (1988): Conductive Heat Extraction to a deep Borehole, Thermal Analysis and Dimensioning Rules. *Energy* 13/6, 509-527
- CLAESSON, J., ESKILSON, P. & HELLSTRÖM, G. (1990): PC Design Model for Heat Extraction Boreholes. - Proc. 3rd WS on SAHPGCS Göteborg, CITη 1990:3, 99-102
- DONNERBAUER, R. (2003): Neuer Trend: Vom Boden an die Wand. – VDI-Nachrichten 16/2003, p. 11, Düsseldorf
- EKLÖF, C. & GEHLIN, S. (1996): TED - a mobile equipment for thermal response test. - 62 p., Master's thesis 1996:198E, Luleå University of Technology
- ESKILSON, P. (1987): Thermal Analysis of Heat Extraction Boreholes. - 264 p., PhD-thesis Lund-MPh-87/13, Lund University of Technology
- ESKILSON, P., CLAESSON, J. (1988): Simulation Model for thermally interacting heat extraction boreholes. *Numerical Heat Transfer* 13, 149-165
- GILBY, D.J., HOPKIRK, R.J. (1985): The coaxial vertical heat probe with solar recharge, numerical simulation and performance evaluation. Proc. 2nd WS on SAHPGCS Vienna, 443-456
- HELLSTRÖM, G. & SANNER, B. (1994): Software for dimensioning of deep boreholes for heat extraction. - Proc. 6th Int. Conf. Energy Storage CALORSTOCK 94, 195-202
- HELLSTRÖM, G., SANNER, B., KLUGESCHIED, M., GONKA, T. & MÅRTENSSON, S. (1997): Experiences with the borehole heat exchanger software EED. - Proc. 7th Int. Conf. Energy Storage MEGASTOCK 97, 247-252
- HELLSTRÖM, G. & SANNER, B. (2001): PC-programs and modelling for borehole heat exchanger design. – Proc. Intern. Geothermal Days Germany 2001, GtV, Geeste, Supplement 35-44, download under: <http://www.uni-giessen.de/~gg1068/html/literatur.html>
- HOPKIRK, R.J., EUGSTER, W.J., RYBACH, L. (1988): Vertical earth heat probes: measurements and prospects in Switzerland. Proc. 4th int. Conf. Energy Storage JIGASTOCK 88, 367-371
- HUBER, A. & SCHULER, O. (1997): Programm-Modul EWS. - IZW-Bericht 2/97, 213-218
- INGERSOLL, L.R. & ZOBEL, O.J. & INGERSOLL, A.C. (1948): Heat conduction with engineering and geological application. - 278 S., McGraw-Hill, New York
- KAVANAUGH, S.P. (1984): Simulation and experimental verification of vertical ground-couple heat pump systems - Ph.D. Dissertation, Oklahoma State University, Stillwater, Oklahoma.
- KAVANAUGH, S.P. & RAFFERTY, K. (1997): Ground-Source Heat Pumps - Design of Geothermal Systems for Commercial and Institutional Buildings - American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE), Atlanta GA.
- KNOBlich, K., SANNER, B. & KLUGESCHIED, M. (1993): Energetische, hydrologische und geologische Untersuchungen zum Entzug von Wärme aus dem Erdreich. - Giessener Geologische Schriften 49, 192 p., Giessen
- MORRISON, A. (2000): GS2000 Software TM. - Proceedings of the Fourth International Heat Pumps in Cold Climates Conference, Aylmer, Québec. August 17-18, 2000

- RYBACH, L., EUGSTER, W.J. (1997): Borehole heat exchangers to tap shallow geothermal resources: The Swiss success story. In: S.F. Simmons, O.E. Morgan & M.G. Dunstall (eds.): Proc. 19th New Zealand Geothermal Workshop. Auckland, 63-69
- SANNER, B. (1986): Schwalbach Ground-Coupled Heat Pump (GCHP) Research Station. - Newsletter IEA Heat Pump Centre 4/4, pp. 8-10, Karlsruhe
- SANNER, B. (1999): Prospects for ground-source heat pumps in Europe. - Newsletter IEA Heat Pump Center 17/1, pp. 19-20, Sittard.
- SANNER, B., REUSS, M., MANDS, E. & MÜLLER, J. (2000): Thermal Response Test - Experiences in Germany. - Proc. TERRASTOCK 2000, pp. 177-182, Stuttgart
- SHONDER, J.A. & HUGHES, P.J. (1998): Increasing confidence in geothermal heat pump design methods. - Proc. 2nd Stockton Geothermal Conference, www.geo-journal.stockton.edu
- SHONDER, J.A. (2000): Comparison of commercially available design software for closed-loop vertical ground heat exchangers. - Proceedings of the Fourth International Heat Pumps in Cold Climates Conference, Aylmer, Québec. August 17-18, 2000.
- SMOLEN, S. & SZAFLIK, W. (1997): Analytische Berechnungsverfahren zur Bestimmung der Temperaturverteilung im Boden für Wärmepumpen mit vertikalen Erdwärmesonden. - IZW-Bericht 2/97, 219-224
- SPITLER, J.D. (2000): GLHEPRO - A Design Tool For Commercial Building Ground Loop Heat Exchangers. - Proceedings of the Fourth International Heat Pumps in Cold Climates Conference, Aylmer, Québec. August 17-18, 2000.
- VAN DE VEN, H. (1999): Status and trends of the European heat pump market. Newsletter IEA Heat Pump Center 17/1, 10-12
- WILHELM, J. & RYBACH, L. (1999): Statistik der Erdwärmennutzung in der Schweiz 1990-1997. Geothermie CH Vol. 9/Nr. 23, 5